



MEPDCL

MEGHALAYA POWER DISTRIBUTION CORPORATION LIMITED
OFFICE OF THE ASSISTANT EXECUTIVE ENGINEER
INVESTIGATION & ENFORCEMENT SUB-DIVISION,
RIBHOI DISTRIBUTION CIRCLE, UMIAM

No. MePDCL /I&E/RBDC/T-96/2024-25/556

Dated Uiam the 27th February, 2025

To,

The Assistant Executive Engineer
Uiam Distribution Sub-Division
MePDCL, Uiam.

Sub: Inclusion of "Additional Units" to electricity bills of M/S Premier Roller Mill & Bakery, Industrial Estate Uiam (Consumer Id.: 1000345340).

Sir,

This is to inform you that the office of the undersigned has on the 16.01.2025 inspected the LT-CT Metering Unit of **M/S Premier Roller Mill & Bakery, Industrial Estate Uiam bearing Consumer No: 1000345340** (details Inspection Report enclosed) and found out that R Ph PT Supply to meter missing due to carbon formation at PT tapping points (corrected).

Therefore, to recover for the loss of energy on account of PT supply failure to meter, inclusion of **2485.33 kVAh** as additional units to the electricity bill of this consumer may kindly be effected from your end and be included into the Electricity Bill Cycle of March, 2025.

This is for your kind information and necessary action.

Encl. Inspection Report & Consumption statement.

Yours faithfully,

(Fullmoon L. Kynshi)

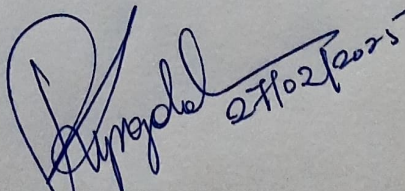
Assistant Executive Engineer-Cum-Assessing Officer
I & E Sub-Division, Ribhoi (D) Circle
MePDCL, Uiam

No. MePDCL /I&E/RBDC/T-96/2024-25/556(a)

Dated Uiam the 27th February, 2025

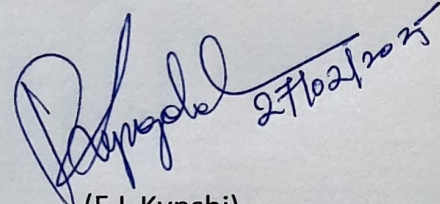
Copy to:-

1. The Superintending Engineer, Ribhoi Distribution Circle, MePDCL, Uiam for kind information.
2. The Superintending Engineer, Investigation & Enforcement, MePDCL, Shillong for kind information.
3. The Executive Engineer, Uiam Distribution Division, MePDCL, Uiam for kind information.
4. The Executive Engineer, High Value Cell, MePDCL, Shillong for kind information.
5. The Manager, M/S Premier Roller Mill & Bakery, Industrial Estate Uiam for kind information.
6. R/F.


ASSISTANT EXECUTIVE ENGINEER

Energy Consumption Statement
Consumer ID/ Account No. 1000345340
Consumer's Name : M/S Premier Roller Mill & Bakery.

Meter Readings for Meter ID: IN4000282 and Meter Status: OK (Normal)					
Description	Date	KWH Meter	Kvah Meter	Recorded Demand	Recorded PF
Reading	06-02-2025	7087.8	10038	1.747	
Reading (PT Supply Correction Date)	16-01-2025	6864.5	9711.8		
No Of Days	21				
Difference		223.3	326.2		
Multiplying Factor		160	160		
Net Consumption		35728	52192	279.52	
Average Per Day Per Phase Consumption		567.11	828.44		
Additional Units to be included (kVAh)		2236.80	2485.33		
Missing R Ph PT Supply detected (as per MRI) on					13-01-2025
R Ph PT Supply corrected on					16-01-2025
No. of days between 13-01-2025 & 16-01-2025					3
R Ph Estimated Consumption (kVAh) between 13-01-2025 & 16-01-2025					2485.33
Number of units (in kVAh) to be compensated as additional units					2485.33


(F.L Kynshi)

Asstt. Executive Engineer cum Assessing Officer
I & E Sub Division, Ribhoi (D) Circle
MePDCL, Umiam.


READING CUM INSPECTION REPORT OF HT CONSUMERS IN UMIAM AREA CONDUCTED ON THE 15th & 16th JANUARY, 2025.

READING CUM INSPECTION REPORT OF HT CONSUMERS IN UMIAM AREA CONDUCTED ON THE 15th & 16th JANUARY, 2025.																				
SL NO	CONS NO	NAME OF CONSUMER	ADDRESS	VOLTAGE LEVEL (KV)	TYPE OF METERING	CONTRACT DEMAND	M/F	METER NO.	CATEGORY	DATE	TIME	READINGS					Old seal	New seal	Remark.	
												KWH	KVAH	KVA	V1	V2				V3
1	1000345379	Mawthlang Wood Product	MIDC	11	LT-CT	190	60	M55001793	IHT	15.01.25	12:07	5350.94	5373.69	1.752	243	244	244	11104105	0.0052477	OK
2	1000345376	lawphniaw saw mill	MIDC	11	LT-CT	68	20	IN4000309	IHT	15.01.25	12:11	5307.90	5964.8	2.858	241	243	243	0.0051903	0.0052479	OK
3	1000345362	MN Sawmill	MIDC	11	LT-CT	180	20	IN4000414	IHT	15.01.25	12:16	14861.70	21110	3.814	245	250	250	0.005177	0.0052473	OK
4	1000345389	Mahabir industries	MIDC	11	LT-CT	95	30	IN4000395	IHT	15.01.25	12:19	3543.10	5278.80	0.88	242	239	214	0.0051915	0.0052474	OK
5	1000345364	Timber Craft Veneer product	MIDC	11	LT-CT	195	60	IN4000310	IHT	15.01.25	12:27	2622.50	3671.20	0.743	242	241	238	0.0051618	0.0052478	OK
6	1000345360	Regitta food Processing PVT Ltd	MIDC	11	LT-CT	112	60	IN4000335	IHT	15.01.25	12:34	2479.10	2998.60	0.388	242	240	237	No seal	0.0052472	OK
7	1000198257	L.L. Nongrum Saw Mill	MIDC	11	LT-CT	92	10	M55001736	IHT	15.01.25	12:41	1666.59	2106.80	1.004	240	241	243	0.0052739	0.0052476	OK
8	1000345373	M/S Saini Timber	MIDC	11	LT-CT	82	20	M55000914	IHT	15.01.25	12:46	517.17	666.2	0.398	243	245	245	0.0051579	0.0052475	OK
9	1000345368	GG Timber & Veneer	MIDC	11	LT-CT	79	30	IN4000420	IHT	15.01.25	12:54	4914.6	6113.4	1.473	242	238	241	5624574	0.0052480	OK
10	1000345343	Shillong Veneer and Saw Mill	MIDC	11	LT-CT	95	30	IN4000425	IHT	15.01.25	12:58	4643.2	6364	1.869	244	241	242	0.0051926	0.0052471	OK
11	1000345410	Megha Plywood	MIDC	11	LT-CT	275	60	IN4000294	IHT	15.01.25	13:05	9364.2	11882.1	2.209	248	249	246	0.0051914	0.0052486	OK
12	1000345375	Megha Forest Product	MIDC	11	LT-CT	68	30	IN4000392	IHT	15.01.25	13:15	1051.1	4276.7	1.083	247	245	245	0.0051913	0.0052489	OK
13	1000345366	S.K Dewasaw Saw Mill	MIDC	11	LT-CT	194	60	IN4000273	IHT	15.01.25	13:21	4260.8	4983.7	0.956	246	247	244	0.0051917	0.0052487	OK
14	1000345400	Shushil Kurbah Tyllying Product	MIDC	11	LT-CT	250	30	IN4000408	IHT	15.01.25	13:27	19232.7	25162	3.631	237	247	244	0.0051617	0.0052488	OK
15	1000345365	Riangdo PVT Ltd	MIDC	11	LT-CT	415	160	IN4000415	IHT	15.01.25	13:33	15472.8	16356.7	2.181	253	255	251	0.0052882	0.0052485	OK
16	1000345369	Meghalaya polymer	MIDC	11	LT-CT	95	60	IN4000293	IHT	15.01.25	13:55	1366.6	1793.8	0.983	236	231	242	0.0051648	0.0052405	Neutral found missing (corrected)
17	1000345371	Vekash Sawmill	MIDC	11	LT-CT	150	60	IN4000422	IHT	15.01.25	14:00	3832.3	5193.21	1.08	248	248	245	0.0051615	0.0052483	OK
18	1000345361	Eastern Saw Mill	MIDC	11	LT-CT	94	60	M55000917	IHT	15.01.25	14:30	1395.29	1450.93	0.502	244	246	244	0.005141	0.0052481	OK
19	1000345398	NESAC Gh & Ab	umiam	11	LT-CT	235	60	M55002802	DHT	15.01.25	14:43	1345.99	1389.6	0.478	243	246	246	Govt,Consumer	OK	OK
20	1000345385	The Principal Nerie	Umiam	11	LT-CT	97	20	IN4000332	DHT	15.01.25	14:48	17783.5	18445.4	3.743	244	244	243	Govt,Consumer	OK	OK
21	1000345350	SIRD Complex	Umroi	11	LT-CT	74	60	IN4000314	BS	15.01.25	15:00	1560.7	1607	0.432	243	244	242	Govt,Consumer	OK	OK
22	1000345367	CAR Farmer Hostel & Engg	Umroi	11	LT-CT	196	60	IN4000338	BS	15.01.25	15:10	5169.6	5322	0.985	236	234	235	Govt,Consumer	OK	OK
23	1000345411	CAR ATTARI	Umroi	11	LT-CT	84	30	M55001795	BS	15.01.25	15:15	630.27	639.84	0.46	234	235	237	Govt,Consumer	OK	OK
24	1000345348	Administrative Officer	Umroi	11	LT-CT	230	60	IN4000426	BS	15.01.25	15:25	13399.1	14388.8	1.885	238	237	238	Govt,Consumer	B-Phase PT found missing (Corrected)	OK
25	1000345351	BSI Complex	Umroi	11	LT-CT	60	20	IN4000283	BS	15.01.25	15:35	1000.7	1053.6	0.676	234	234	222	Govt,Consumer	OK	OK
26	1000345347	NEPA	Umsaw	11	LT-CT	250	80	M55002801	BS	15.01.25	15:47	7566.54	7680.05	1.848	244	243	244	Govt,Consumer	OK	OK
27	1000345402	The Director NEPA	Umsaw	11	LT-CT	250	60	IN4000454	BS	15.01.25	15:55	2959.9	3025.6	0.496	235	235	235	Govt,Consumer	B-Phase PT found missing (Corrected)	OK
28	1000345345	Jackwell Barapani	Umiam	11	LT-CT	120	60	IN4000301	BS	15.01.25	16:21	11412.2	11847.2	1.105	232	237	246	Govt,Consumer	OK	OK
29	1000345403	Meghalaya Bio Energy	MIDC	11	LT-CT	400	160	M55004067	IHT	16.01.25	13:02	3207.64	3455.84	1.552	248	245	246	0.0052738	0.0052433	OK
30	1000345395	Pine poly Pack	MIDC	11	LT-CT	170	60	IN4000504	IHT	16.01.25	13:14	8250.4	9488	2.95	244	245	250	0.0052881	0.0052247	OK
31	1000345399	M/S Girik Briquettes	MIDC	11	LT-CT	185	30	IN4000281	IHT	16.01.25	13:34	15032.4	19824.2	6.276	243	244	242	0.0052808	0.0052435	OK
32	1000639726	M/S Meghalaya Roofing	MIDC	11	LT-CT	64	20	IN4000491	IHT	16.01.25	13:28	991.9	1205.9	0.487	244	247	247	0.0052455	0.0052439	OK
33	1000345408	SKM Associate	MIDC	11	LT-CT	58	20	IN40000418	IHT	16.01.25	13:31	2355.4	2496.2	0.816	250	249	249	0.0051594	0.0052438	OK
34	1000345340	Premiere Roller Mill	MIDC	11	LT-CT	427	160	IN4000282	IHT	16.01.25	13:44	6864.5	9711.8	1.63	241	240	240	0.0051591	0.005244	R-Phase PT found missing (Corrected)
35	1000345353	Premier Hatchery	MIDC	11	LT-CT	67	20	M55001473	IHT	16.01.25	13:48	3119.23	3614.51	1.988	245	244	244	0.0052453	0.0052494	OK
36	1000345352	Tourist Complex MTDC	Umiam	11	LT-CT	135	60	IN4000461	BS	16.01.25	14:07	4690.3	4933.3	0.78	248	218	229	1104601	0.0052499	OK
37	1000345405	Deidakine Resort	Umbir	11	LT-CT	191	60	IN4000316	IHT	16.01.25	14:23	3687.1	3826.7	0.998	227	281	222	0.0051477	0.0052492	OK
38	1000345397	P.D Siawian, Rikyriai Resort	Umiah	11	LT-CT	141	60	M55004707	CHT	16.01.25	14:45	2413.62	2500.45	1.366	245	245	243	no seal	0.0052493	OK
39	1000345407	Rishatngri Resort	Umiam	11	LT-CT	153	30	IN4000272	CHT	16.01.25	15:00	5489.5	5708.8	1.183	202	251	280	no seal	0.0052498	OK
40	1000345392	M/S Syrai Automotive	Mawiong	11	LT-CT	100	30	M55000757	CHT	16.01.25	15:17	1069.6	1088.34	0.722	242	243	242	0.0052457	0.0052438	OK
41	1000345384	Highland Toyota	Mawiong	11	LT-CT	94	60	M55004462	CHT	16.01.25	15:22	357.79	382.62	0.868	242	243	242	0.0052452	0.0052497	OK

42	1000345393	Renikton L Tongkhar	Mawiong	11	LT-CT	106	60	MS5004071	CHT	16.01.25	15:26	635.57	706.89	0.526	242	243	242	0.0052459	0.0052495	OK
----	------------	---------------------	---------	----	-------	-----	----	-----------	-----	----------	-------	--------	--------	-------	-----	-----	-----	-----------	-----------	----

Note: (1) Attention may kindly be paid to the underline bolted remarks.

(2) Cells which are left blank indicate either "No Data Available" or "Not Applicable" during inspection.


(F.L. KYNSHI)
ASSISTANT EXECUTIVE ENGINEER
Investigation & Enforcement Sub-Division
MePDCL, Umiam