



MePDCL

MEGHALAYA POWER DISTRIBUTION CORPORATION LIMITED
OFFICE OF THE ASSISTANT EXECUTIVE ENGINEER
INVESTIGATION & ENFORCEMENT SUB-DIVISION
RIBHOI DISTRIBUTION CIRCLE, UMIAM
Email: aeeie.rb.mepdcl@meghalaya.gov.in

No. MePDCL /I&E/RBDC/T-96/2025-26/611

Dated Umiyam the 27th May, 2025

To,

The Assistant Executive Engineer,
Umiyam Distribution Sub-Division
MePDCL, Umiyam.

Sub: CT Replacement Report & Additional Units (kWh) to be included into the electricity bill of S.B.I., Umiyam (Consumer Id.: 1000197925).

Sir,

This is to inform you that the office of the undersigned has on the 27.05.2025 inspected the LT-CT Metering unit of **S.B.I., Umiyam (Consumer Id.: 1000197925)** and has found that Y Phase CT was defected (Sec. current is zero for all primary currents). Y Ph CT has been replaced with new CT (CTR;50/5A) today the 27-05-2025 at 17:00 Hrs.

In light of the above and to account for the loss of revenue to MePDCL due to Y Ph CT failure, **5076.00 kWh** of Additional Units may please be included into the electricity bill of this consumer (Bill Cycle of June, 2025).

This is for your kind information and necessary action.

Encl. Assesment of Additional Unit.

Yours faithfully,

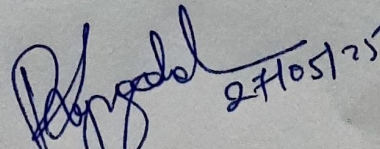
(Fullmoon L. Kynshi)
Assistant Executive Engineer-Cum-Assessing Officer
I & E Sub-Division, Ribhoi (D) Circle
MePDCL, Umiyam

No. MePDCL /I&E/RBDC/T-96/2025-26/611(a)

Dated Umiyam the 27th May, 2025

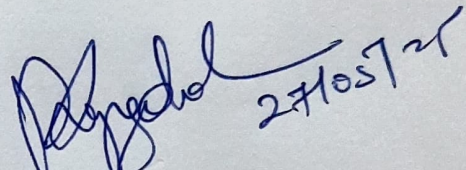
Copy to:-

1. The Superintending Engineer, Ribhoi Distribution Circle, MePDCL, Umiyam for kind information.
2. The Superintending Engineer (I & E), MePDCL, Shillong for kind information.
3. Executive Engineer, Umiyam Distribution Division, MePDCL, Umiyam for kind information.
4. Executive Engineer, MTI Division, MePDCL, Shillong for kind information.
5. The Junior Engineer (Central Billing Section), Umiyam Distribution Division, MePDCL, Umiyam for kind information and necessary action to include the additional unit as mentioned.
6. The Branch Manager, S.B.I., Umiyam for kind information.
7. R/F.


ASSISTANT EXECUTIVE ENGINEER

Energy Consumption Statement
Consumer ID/ Account No. 1000197925
Consumer's Name : S.B.I., Umiam.

Meter Readings for Meter ID: MEB90169 and Meter Status: OK (Normal)					
Description	Date	KWH Meter	Kvah Meter	Recorded Demand	Recorded PE
Reading	27-May-25	18401.5			
Reading	22-May-24	17386.3			
No Of Days	370				
Difference		1015.2			
Multiplying Factor		10			
Net Consumption (R&B)		10152		0	
Average Per Day Consumption (APDC)		27.44			
Additional Units to be included (kWh) (R+B)/2		5076.00			
Number of units (in kWh) to be compensated as additional units					5076.00


(F.L Kynshi)

Asstt. Executive Engineer cum Assessing Officer
I & E Sub Division, Ribhoi (D) Circle
MePDCL, Umiam.