



MePDCL

MEGHALAYA POWER DISTRIBUTION CORPORATION LIMITED

OFFICE OF THE ASSISTANT EXECUTIVE ENGINEER

INVESTIGATION & ENFORCEMENT SUB-DIVISION

RIBHOI DISTRIBUTION CIRCLE, UMIAM

Email: aeeie.rb.mepdcl@meghalaya.gov.in

No. MePDCL /I&E/RBDC/T-96/2025-26/610

Dated Umiam the 27th May, 2025

To,

The Assistant Executive Engineer,
Umiam Distribution Sub-Division
MePDCL, Umiam.

Sub: Metering correction & Additional Units (kVAh) to be included into the electricity bills of M/S Timber Craft Plywood, MIDC, Umiam (Consumer Id.: 1000639432).

Sir,

The HT metering unit M/S Timber Craft Plywood, MIDC, Umiam (Consumer Id.: 1000639432) employs 3P3W 11KV CT-PT Unit (PTR=11000/110V, CTR=20/5A) and 3P4W 110V, -/5A Secure Ltd Make Meter (O.M.F=400). However, the undersigned has found the connection done at the meter terminal as 3P3W (wrong connection as Y Ph current is not accounted) resulting to the meter recording R & B phase energy only (66.67%). Correction has been done today the 27-05-2025 at 11:00 Hrs.

In light of the above and to account for the loss of revenue to MePDCL due to wrong meter connection, **345984.00 kVAh** of Additional Units may please be included into the electricity bill of this consumer.

To reduce the burden on the consumer, the Additional Units above may please be included in installment month wise as follows:

Sl. No.	Bill Cycle	Quantum of Additional Units (kVAh)
1	Jun-25	43248
2	Jul-25	43248
3	Aug-25	43248
4	Sep-25	43248
5	Oct-25	43248
6	Nov-25	43248
7	Dec-25	43248
8	Jan-26	43248

This is for your kind information and necessary action.

Encl. Assesment of Additional Unit.

Yours faithfully,

(Fulmoon L. Kynshi)

Assistant Executive Engineer-Cum-Assessing Officer

I & E Sub-Division, Ribhoi (D) Circle

MePDCL, Umiam

No. MePDCL /I&E/RBDC/T-96/2025-26/610(a)

Dated Umiam the 27th May, 2025

Copy to:-

1. The Superintending Engineer, Ribhoi Distribution Circle, MePDCL, Umiam for kind information.
2. The Superintending Engineer (I & E), MePDCL, Shillong for kind information.
3. Executive Engineer, Umiam Distribution Division, MePDCL, Umiam for kind information.
4. Executive Engineer, MTI Division, MePDCL, Shillong for kind information.
5. The Junior Engineer (Central Billing Section), Umiam Distribution Division, MePDCL, Umiam for kind information and necessary action to include the additional unit as mentioned.
6. M/S Timber Craft Plywood, MIDC, Umiam (Consumer Id.: 1000639432) for kind information.
7. R/F.

ASSISTANT EXECUTIVE ENGINEER

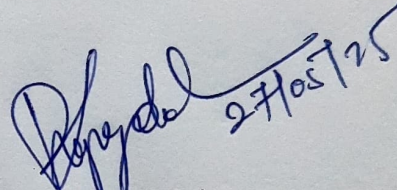
Energy Consumption Statement
Consumer ID/ Account No. 1000639432
Consumer's Name : M/S Timber Craft Plywood

Meter Readings for Meter ID: MEB97813 and Meter Status: OK (Normal)					
Description	Date	KWH Meter	KvAh Meter	Recorded Demand	Recorded PF
Reading (Metering Correction Date)	27-05-2025	1168.23	1729.92		
Multiplying Factor		400	400		
Net Consumption		467292	691968		
Additional Units to be Included (kWh)=Total Unit/2		233646.00	345984.00		
Number of units (in kVAh) to be compensated as additional units					345984.00

Note: (1). This consumer has no Meter Change History and uses the same Meter No. MEB97813 since the date of service on 06-06-2022.

(2). Correction has been made by looping RS2 & BS2 to YS2 (of Meter). YS1 (of Meter) returns as 1S2 & 3S2 (of CT-PT Unit).

(3). Pre-correction, the meter has been recording R & B Phases only. Additional Unit (Unit loss) is half of R & B Phases.


(F.L. Kynshi)

Asstt. Executive Engineer cum Assessing Officer
I & E Sub Division, Ribhoi (D) Circle
MePDCL, Umiam.