

CONSUMER DETAILS


Name	M/S Eastline Bamboo Industries
Address	MIDC
Category	IHT
Load	450 KVA
Meter No.	MS5005475
Meter Brand	HPL
SIM Type	NIL
SIM No.	NIL
OMF	4
TMC	No
Date of Connection	11-Aug-25
Load Security	1895400
Service Connection / HT Metering	238420

DT Details

DT Capacity	630 KVA
Serial Number	
Manufacture Date	
Brand	SAI ELECTRICAL

HT METERING REPORTS

SUB DIVISION :-	Umiam Distribution Sub Division, Me PDCL, Umiam
CONSUMER NAME:-	M/S Eastline Bamboo at MIDC Umiam,
ADDRESS:-	Umiam
CATEGORY:-	IHTT
Date of connection :-	11/08/2025
Meter Number –	MS5005475 (HPL)
Meter ownership:-	Consumer
Metered o LT/HT side :-	HT side
Connected Load-	450 KVA
Contracted Demand-	450 KVA
Whether consumer opted for TMC:-	No
Transformer Capacity:-	630KVA
Whether consumer opted for CTPT Maintenance:-	No
Make :	Shree SAI Electrical make.
Initial Meter Reading (i) Kwh:-	0.00
(ii) Kvah:-	0.00
(iii) Kva :-	00.00
Voltage:	11 KV
Phase Sequence:	Foward
OMF	:-4(Four)
Seal no :	i) 9228226. ii) 9228227. iii) 9228600. iv) 9228637


Assistant Executive Engineer
Umiam Dist Sub Division
MePDCL, Umiam

MEGHALAYA POWER DISTRIBUTION CORPORATION LIMITED

OFFICE OF THE EXECUTIVE ENGINEER, UMIAM DISTRIBUTION DIVISION, UMIAM

2009SGC008394

Email: - ee.umiham.mepdcl@meghalaya.gov.in .com

(0364)570541/70856-49704

No. MePDCL/EE/UDD/MC-02/2025-26/

Dated, Umiham, the _____ September 2025

To,

Shri Akshay Choudhary ,
M/s.Eastline Bamboo Industries.
Umiham Industrial Area,MIDC
Umiham,Ri-Bhoi District.

Sub:

Agreement for Power Supply at M/s.Eastline Bamboo Industries.at MIDC, Umiham Ri-Bhoi District.

Sir,

With reference to the subject above, please find enclosed herewith a copy of the signed Agreement for Supply of Electricity at High Tension at 11 KV and categorized as Industrial High Tension (IHT).

The Agreement for Contract Demand against Load 450 KVA is effective from the date of signing the Agreement and for the period of 5 years i.e with effect from (August 2025 to August 2030).

Enclose:As stated

Yours Sincerely,

(M.M. Rymbai)
Executive Engineer,
Umiham Distribution Division,
MePDCL,Umiham

Memo No. MePDCL/EE/UDD/T-⁰²48/2025-26/ 595 (a) Dated, Umiham, the 4 August 2025

Copy to:

1. The Superintending Engineer, Ri-Bhoi Distribution Circle, MePDCL, Umiham, for favour of kind information.
- ✓ 2. The Asst. Executive Engineer Umiham Distribution Sub Division, MePDCL, Umiham for information and necessary action.

EXECUTIVE ENGINEER, UDD *NAM*

INDIA NON JUDICIAL

Government of Meghalaya

e-Stamp

Certificate No. : IN-ML09544846410418X
Certificate Issued Date : 08-Aug-2025 11:14 AM
Account Reference : CSCACC (GV)/ mlcsceg07/ ML-RBMIC0027/ ML-RB
Unique Doc. Reference : SUBIN-MLMLCSCEG0716822318111820X
Purchased by : EASTLINE BAMBOO INDUSTRIES
Description of Document : Article 5 Agreement or Memorandum of an Agreement
Property Description : Not Applicable
Consideration Price (Rs.) : 0
(Zero)
First Party : MePDCL UMIAM
Second Party : EASTLINE BAMBOO INDUSTRIES
Stamp Duty Paid By : EASTLINE BAMBOO INDUSTRIES
Stamp Duty Amount(Rs.) : 100
(One Hundred only)

AGREEMENT FOR SUPPLY OF ELECTRICITY
(HIGH TENSION/EXTRA HIGH TENSION)
Industrial High Tension (IHT)

AGREEMENT made this day the 11th August, 2025 between M/S. Eastline Bamboo Industries (hereinafter referred to as 'the Consumer') and the Meghalaya Power Distribution Utility Limited an electricity distribution licensee under the Electricity Act 2003 (hereinafter referred to as the "MePDCL" and which term shall include its successors and assigns) of the other Part.

WHEREAS, the consumer is M/S. Eastline Bamboo Industries here briefly mentioned the nature of business/work/activity of Industries and requires electricity of quantum **450 KVA** at 11 KV voltage lever for the purpose of Industries.

GG 0019780135

Statutory Alert:

1. The authenticity of this Stamp certificate should be verified at 'www.shreestamp.com' or using e-Stamp Mobile App of Stock Holding Corporation of India.
2. Any discrepancy in the details on this Certificate and as available on the website / Mobile App renders it invalid.
3. The onus of checking the legitimacy is on the users of the certificate.
4. In case of any discrepancy please inform the Competent Authority

HEREAS, the consumer has applied to the MePDCL for supply of the electricity and the MEPDCL has agreed to supply it;

AND THEREFORE, the parties hereto mutually agree as follow:

1. That the total connected load shall be 450 KVA as declared in the Annexure appended hereto.
2. That the Contracted Load of supply shall be
 - a. 450 KVA for the 1st year,
 - b. 450 KVA for the 2nd year,
 - c. 450 KVA for the 3rd year,
 - d. 450 KVA for the 4th year,
 - e. 450 KVA for the 5th year
3. That the consumer shall draw power of not less than 75% and not more than 100% percent of the contracted load.
4. That the consumer shall not sell the electricity supplied except utilizing it for the purpose herein before stipulated and shall not charge tariff other the approved by the commission from time to time.
5. That the provisions of the Electricity Act 2003 and of the Regulations, Code and Orders, including Tariff Orders, as may be made from time to time by the Meghalaya State Electricity Commission shall apply in matters including disputes, if any, relating to supply of electricity under this Agreement.
6. That the consumer shall regularly and timely pay to the Distribution utility all charges as may be due for the supply of electricity.
6. (a) That the maintenance and replacement of the Transformer on account of failure shall be the responsibility of the consumer at his own cost (**Self Procurement**)
7. That the Agreement shall be for a period of 5 (five) years from the date of its execution subject to renewal on terms as may be mutually agreed upon and the terms and conditions thereof shall specifically be effective from the date supply of the electricity is commenced.
8. That the Agreement shall be terminated if the consumer on its part desires it so and gives to the MePDCL a prior notice of not less than one month or on the part of the MePDCL, if the consumer has violated any of the terms and conditions of the Agreement.
Provided that on the part of the MePDCL notice shall be given to the consumer stating the reasons for the proposed termination and giving him opportunity to state his case and his statement, if any, duly considered before the Agreement is terminated and the supply of electricity cut off.

SS WHEREOF the parties hereto have set their respective hands and seals the date,

~~Eastline Bamboo Industries~~

A. Choudhary

Shri. Akshay Choudhary, ~~OPartner~~

M.M. Rymbai

Shri. M.M. Rymbai, Executive Engineer

For and on behalf of and by authorization
the consumer
Limited.

For and on behalf of and by authorization of
Meghalaya Power Distribution Corporation

WITNESS:

Name	Designation/Occupation	Signature
1. Shri. D. BLAH	A E E / C.	<i>[Signature]</i> Assistant Executive Engineer Umiam Distribution Sub-Division MePDCL, Umiam
2. Anmol Choudhary	Partner	<i>Anmol</i>
3. Aayush Kotecha	Partner	<i>Aayush Kotecha</i>

Declaration / Undertaking

I, **Shri. Akshay Choudhary, Owner** Son of **Shri. Manoj Choudhary** Resident of **Choudhary Bhawan Ullubari, G.S, Road, Guwahati- 781007, Assam** (hereinafter referred to as "Applicant", which term shall mean and include executors, administrators, heirs, successors and assigns), do hereby swear and declare as under.

M/S. Eastline Bamboo Industries, Firms having its registered office at **MIDC, Umiam Ri-Bhoi District, Meghalaya-793103**(hereinafter referred to as "Applicant", which term shall, unless repugnant to the context or meaning thereof, include its successors and assigns), do hereby swear and declare as under:

That the Applicant is a lawful occupant of the premises at **M/S. Eastline Bamboo Industries, MIDC, Umiam Ri-Bhoi District, Meghalaya**. In support of which the Applicant has enclosed a proof of occupancy.

That the Applicant has requested the Licensee to provide a service connection at the above-mentioned premises in the Applicant's name for the purpose mentioned in the application form.

That in furnishing the Declaration, the Applicant has clearly understood that should the above statement prove to be false or incorrect at any later stage, the Licensee shall have every right to disconnect supply to the Applicant without any notice and above right to adjust dues against Consumer Security Deposit.

That the Applicant hereby agrees and undertakes:

1. To indemnify the Licensee against all proceedings, claims, demands, cost, damages, expenses that he Licensee may incur by reason of a fresh service connection given to the Applicant.
2. That all Electrical Works done within the premises are as per Indian Electricity Rules and have been carried out by a licensed electrical contractor (in case the Applicant is an owner and wiring in the premises is new)

Or

That all Electrical Work done within the premises are as per Indian Electricity Rules to the best of our knowledge (where application is for reconnection or Applicant is occupier of the premises)

3. The Licensee is indemnified against any loss accrued to the applicant on this account. further, Applicant agrees that if there is any harm/loss to the property of the Licensee due to the fault in Electrical work within the premises of Applicant, all the liabilities shall be borne by the Applicant.
4. To pay the electricity consumption bills and all other charges at the rates set out in the Licensee's Tariff Schedule and miscellaneous charges for supply as may be in force from time to time, regularly as and when the same become due for payment.

To deposit the additional consumption deposit as revised by the Licensee from time to time based on the consumption of the Applicant in preceding year.

6. To abide by the provisions of the Electricity Act, 2003, Meghalaya Electricity Supply Code, tariff order and any other rules or regulation notified by the Commission, as applicable from time to time.
7. That Licensee shall be at liberty to adjust the electricity consumption charges along with any other charges against the Consumer Security Deposit paid by the Applicant, in the event of termination of the agreement prior to expiry of the contracted period or in case of nay contractual default.
8. To be responsible for safe custody of Meters, CTs, Cables etc. provided by the Licensee and in case, there is any damage to equipment due to the reasons attributable to Applicant the same shall be chargeable to the Applicant. Further, all repercussions on account of breakage of seals of meters etc. or Direct/ Dishonest Abstraction of energy shall be to the account of Applicant, as per the existing laws.
9. To allow clear and un-encumbered access to the meters for the purpose of meter reading and its checking etc.
10. That the Applicant would let the Licensee disconnect the Service connection under reference, in the event of any default, non-compliance of statutory provisions and in the event of a legally binding directive by Statutory Authority(ies) to affect such an order. This shall be without prejudice to any other rights of the Licensee including that of getting its payment as on the date of disconnection.
11. That the Licensee shall not be held responsible for any interruption or diminution of supply of Electricity.
12. All the above declaration given by the Applicant shall be construed to an Agreement between the Licensee and the Applicant.

Eastline Bamboo Industries



Partner

Signature of the Applicant
Name of the applicant:


SIGNED AND DELIVERED
In presence of witness

Name of Witness:

1. Arvind Choudhary



2. Anupam Kotecha



SHALAYA POWER DISTRIBUTION CORPORATION LIMITED

OFFICE OF THE EXECUTIVE ENGINEER UMIAM DISTRIBUTION DIVISION, UMIAM

MePDCL/EE/UDD/MC-02/2024-25/ 879

☎: (0364) 2570 541

Dated, Umiam, the 24th October 2024

To,

✓
The Assistant Executive Engineer,
Umiam Distribution Sub Division,
MePDCL, Umiam.

Sub:

Technical Sanction for Providing Power Supply to Eastline Bamboo Industries at, MIDC , Umiam
, Ri-Bhoi District under Deposit Works.

Ref:

1. Administrative Approval MePDCL/SE/RBDC/T-0428/2024-25/1372


Dt 20.09.2024.

With reference to the above, and in accordance with approved amended DOFP vide letter No MeECL/CA/GA-II/133/2005/PT/73 Dt 26th March 2024 , as 11(A). Technical Sanction of the Estimate for Construction of 11 KV Line, 11/0.4 KV, 630 KVA Sub-station and HT Metering for Providing Power Supply to Eastline Bamboo Industries at ,MIDC Umiam, Ri-Lhoi District, amounting to Rs 37,76,529.00 (Rupees Thirty Seven Lakh Seventy Six Thousand Five Hundred and Twenty Nine) only)Only, is hereby accorded.

The expenditure is booked under Head of Account Deposit Works and entered in the Technical Register 2024-25 of this Division.

This is for your information and necessary action from your end.

Encl: Approved estimate.


E.N. Kharbuki,
Executive Engineer

No. MePDCL/EE/UDD/MC-02/2024-25/

Copy to:

Dated, Umiam, the _____, October 2024

1. The Superintending Engineer, Ri-Bhoi Distribution Circle, MePDCL, Umiam for favour of kind information

EXECUTIVE ENGINEER, UDD.

MEGHALAYA POWER DISTRIBUTION CORPORATION LIMITED
OFFICE OF THE SUPERINTENDING ENGINEER, RI-BHOI DISTRIBUTION, CIRCLE
UMIAM

* * * * *

"Save Energy for Benefit of Self & Nation"

101ML2009SGC0083944

Email: se.rbdc.umiain@gmail.com

☎ : 0364 2570264

No. MePDCL/SE/RBDC/T-0428/2024-25/ 1372

Dated Umiain the 18th Oct, 2024

To,

✓ The Executive Engineer,
Umiain (Dist) Division
MePDCL, Umiain

EE
for info
18/10/24

Sub:

Administrative Approval of estimate for providing Power Supply to M/s. Eastline Bamboo Industries at MIDC, Umiain under Deposit works.

Ref:

No. MePDCL/EE/UDD/MC-02/2024-25/739

Dated 27.09.2024

With reference to the above and accordance with approved amended DOFP vide letter No. MeECL/CA/GA-II/133/2005/PT/73 dated 26th March 2024 as per Sl. 5(a). Administrative Approval is hereby accorded for construction of 11KV line, 11/0.4KV, 630KVA Sub-Station including Civil Works for Sub-Station Fencing, Rain Shade and HT Metering for providing Power Supply to M/s. Eastline Bamboo Industries at MIDC, Umiain amounting to Rs. 37,76,529.00 (Rupees Thirty seven lakhs seventy six thousand five hundred twenty nine) only under deposit works.

Technical Sanction may be accorded from your end. The work is to be taken up after observing all official formalities.

Encl: As above

Executive Engineer
Umiain Distribution Division
MEPDCL, Umiain

Dairy No 1396 Dt 18/10/24

Yours faithfully,

(J. L. Kharmih)

Superintending Engineer
Ri-Bhoi (Dist) Circle, Umiain

Dated Umiain the ___ Oct, 2024

Memo: No. MePDCL/SE/RBDC/T-0428/2024-25/
Copy to:

1. The Chief Engineer, (D), (EZ) MePDCL, Shillong for favour of kind information
2. The Asst. Executive Engineer, (UDSD), MePDCL, Umiain for information

Superintending Engineer
Ri-Bhoi (Dist) Circle, Umiain


*//**//**// * //**//**//*

LOAD DECLARATION

620

Work	Construction of 11 KV Line, 11/0.4 KV 500 KVA S/S, Service Connection and Metering for Providing power supply to EASTLINE BAMBOO INDUSTRIES AT MIDC UMIAM under Deposit Works
and Load, KVA	360 KW Or 450 KVA
Name of 33/11 KV Sub-station with Capacity which is the source of supply	33/11 KV 2X5 MVA New Colony Sub-Station
3 Peak Load of 33/11 KV 2X5 MVA New Colony Sub-Station	376 Amp on 11KV side
4 Present load clearance available in 33/11 KV New Colony Sub-Station	146.86 Amp
5 Name of 11 KV Feeder	MIDC
6 Remark if any	Supply can be given

Load of 360.0 KW Sanctioned from 33/11 KV, 2x5 MVA New Colony Sub-Station with installation of 11/0.4 KV, 630 KVA Transformer.


Executive Engineer
Umiyam Distribution Division
MePDCL, Umiyam


**OF ESTIMATE FOR PROVIDING POWER SUPPLY TO EASTLINE BAMBOO INDUSTRIES
AT MIDC UMIAM UNDER DEPOSIT WORKS**

No	Particulars	Amount (Rs)
1	Construction of 11 KV Line	474632.00
2	Construction of 11/0.4 KV, 630 KVA Sub-station <i>Rs 8,53,339.00</i>	842684.19
3	Construction of Brick Wall Fencing <i>Rs 2,83,181.00</i>	283108.58
	Construction of Rain shade	19757.49
4	HT Metering <i>Rs 2,38,420.00</i>	254126.00
5	Load Security of IHT for 450 KVA @ 4212/KVA = 450 KVA X Rs: 4212.00	1895400.00
6	Application Fee <i>inclusive 18% GST</i>	236.00-11800.00
7	Total Rs: <i>37,76,529.00</i>	3769944
Rupees (Thirty Seven Lakh Sixty Nine Thousand Nine Hundred and Fourty Four) only.		

(Rupees Thirty Seven Lakhs Seventy Six Thousand Five Hundred Twenty Nine) only

16/10/24
Assistant Executive Engineer
Umiyam Distribution Sub-Division
MEPDCL, Umiyam

27/10/24
Executive Engineer
Umiyam Distribution Division
MEPDCL, Umiyam

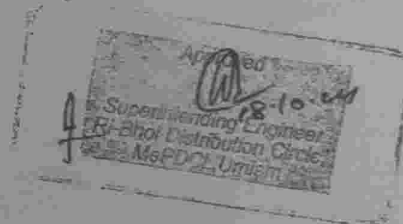

**FOR CONSTRUCTION OF 11KV LINE AT MIDC UMIAM AS DESIRED BY EASTLINE
BAMBOO INDUSTRIES UNDER DEPOSIT WORKS**

11KV LINE = 0.2 KM

Items	Qty	Unit	Rate (Rs)	Amount (Rs)
G.I. Steel Tubular Pole 9.5 M	5	Nos	25800.00	129000.00
Channel Cross Arm 75*40*4.8*2280 mm	15	Nos	2476.80	37152.00
ACSR Weasel Conductor	0.63	KM	36842.01	23210.47
Disc Insulator 45 KN	24	Nos	668.11	16034.64
Hardware Fitting for Weasel Conductor	12	Sets	327.98	3935.76
11 KV Pin Insulator	18	Nos	161.79	2912.22
GI Pin for 11 KV Pin Insulator	18	Nos	126.85	2283.30
HT Stay Set Complete	6	Set	1458.78	8752.68
GI Stay Wire 7/10 Swg	42	Kgs	121.91	5120.22
Guy Insulator 88 KN	6	Nos	55.08	330.48
11 KV Lightning Spike	5	Nos	423.57	2117.85
Brazing Set (Z - Type)	4	Set	3733.21	14932.84
11 KV DO Fuse Unit 200 Amps	1	Set	6702.63	6702.63
Jam Clamp 9.5/12 ND M (T)	15	Sets	323.53	4852.95
Pole Clamp 9.5/12 ND M (T)	23	Nos	143.23	3294.29
Pole Clamp 9.5/12 ND M (M)	8	Nos	149.00	1192.00
Pole Clamp 9.5/12 ND M (B)	4	Nos	175.83	703.32
Stay Clamp 9.5/12 ND M (Top)	6	Pairs	331.69	1990.14
GI Earthing Pipe 40 mm dia.	5	Nos	504.18	2520.9
GI Wire 8 Swg	35	Kgs	115.56	4044.60
GI Through N/B 5/8"X 10"	35	Nos	57.08	1997.80
Nuts & Bolts 5/8"X 4"	36	Kgs	117.44	4227.84
11 KV Danger Plates	3	Nos	92.24	276.72
Cement for Grouting of Poles & Stay Set	16	Bags	500.00	8000.00
Sundries (Drilling, Cutting & Holling of Channel)	LS	LS		3000.00
A	Total Cost of Materials			288585.65
B	Labour Charge @ 20 % On 'A'			57717.13
C	Sub Total (A+B)			346302.78
D	Departmental charge @ 15 % of 'C'			51945.42
E	Taxable Value (C+ D)			398248.19
F	GST @ 18 % of 'E'			71684.67
G	Total			469932.87
H	Labour Cess @ 1 % on 'G'			4699.33
I	Grand Total			474632.20
J	SAY			474632.00

(Rupees Four Lakh Seventy Four Thousand Six Hundred and Thirty Two) only

Prepared by:


Junior Engineer


Umiyam Distribution Sub-Division
MePDCL, Umiyam


Executive Engineer

Umiyam Distribution Division
MEPDCL, Umiyam


Assistant Executive Engineer

Umiyam Distribution Sub-Division
MePDCL, Umiyam


18-02-2024

**ESTIMATE FOR CONSTRUCTION OF 11/0.4KV, 630KVA DT AT MIDC UMIAM AS DESIRED BY
EASTLINE BAMBOO INDUSTRIES UNDER DEPOSIT WORKS**

No	Items	Qty	Unit	Rate (Rs)	Amount (Rs)
1	Channel Cross Arm 100*50*6*2800 mm	2	No.	4040.27	8080.54
2	Channel Cross Arm 75*40*4.8*2280 mm	4	No.	2476.80	9907.20
3	LT X-arm 45x45x460mm	2	No.	266.98	533.96
4	Jam Clamp (50*5 MS flat & 50*50*6 MS angle) for 8.0 Mt.	2	Set	321.53	643.06
5	Pole Clamp 9.5 M (Top)	2	No.	143.23	286.46
6	Pole Clamp 9.5 M (Middle)	4	No.	149.00	596.00
7	Pole Clamp 9.5 M (Bottom)	4	No.	175.83	703.32
8	Nuts & Bolts M/S, GI Through 5/8x10"	7	No.	57.08	399.56
9	M.S. Nuts & Bolts 5/8"X 4"	6	No.	117.44	704.64
10	11 KV Danger Plates	2	Nos	92.24	184.48
11	GI Wire 8 SWG	20	Kg	115.56	2311.20
12	Earthing Electrode of 2 meters long/50mm wall diameter /2.89mm thickness/Terminal 30x10mm/inner pipe/outer pipe of 250-100 microns galvanized with one (1.0) bag (22Kgs) BFC (Ultra)	3	Nos	7,153.05	21459.15
13	11/0.4 KV 630 KVA Distribution Transformer(Exclusive GST)	1	No	1450000.00	1450000.00
14	11 KV DO Fuse Unit 200 Amps	1	Set	6702.63	6702.63
15	11 KV Lightning Arrester (Line type)	3	Nos	752.50	2257.50
16	11 KV Pin Insulator	6	Nos	161.79	970.74
17	GI Pin for 11 KV Pin Insulator	6	Nos	126.85	761.10
18	Moulded Case Circuit Breaker (MCCB) 415V AC,500A Four Poles (Model No.HD3HUBF0500)	1	Nos	62594.83	62594.83
19	1- Core LT Cable 630 Sq. Mm (Armoured) Havells	50	Mts	2763.18	138159.00
20	Sundries (Wooden Plank, All. Lugs, Small Size N/B, etc.)	LS	LS	5000.00	5000.00
A	Total Cost of Materials			1712259.57	1712272.55
B	Add Labour Charge @ 10 % on 'A'			171225.96	171227.26
C	Sub-Total-(A+B)			1883485.53	1883499.81
D	Departmental charge @ 15 % of 'C'			282522.83	282524.97
E	Sub-Total-(C+D)			2166008.36	2166024.78
F	Less cost of self-procured 11/0.4 KV,630 KVA Transformer (Exclusive of GST)				(-) 1450000.00
G	Taxable Value (E-F)			716008.36	716024.78
H	GST @ 18 % of 'G'			128881.50	128884.46
I	Sub-Total (G+H)			844889.86	844909.24
J	Labour Cess @ 1 % on 'I'			8448.89	8449.09
K	Grand Total (I+J)			853338.75	853358.33
L	Grand Total			853339.00	853358.00

(Rupees Eight Lakh Fifty Three Thousand Three Hundred and Twenty Eight only)


(Rupees Eight Lakhs Fifty Three Thousand Three Hundred and Twenty Nine) Only.

Junior Engineer
Umiyam Distribution Sub-Division
MePDCL, Umiyam

CIS

Assistant Executive Engineer
Umiyam Distribution Sub-Division
MePDCL, Umiyam

29/9/24
Executive Engineer
Umiyam Distribution Division
MEPDCL, Umiyam

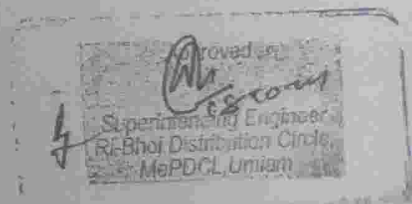

**INSTALLATION OF HT METERING FOR 11/0.4KV, 630 KVA DT AT MIDC UMIAM AS DESIRED
BY EASTLINE BAMBOO INDUSTRIES UNDER DEPOSIT WORKS**

Items	Qty	Unit	Rate (Rs)	Amount (Rs)	Remarks
1 KV CT-PT, 3 Phase 4 Wire (3 CT + 1 Three Phase PT) accuracy class 0.5S, Ratio: 10-20/5 A	1	Set	81834.38	81834.38	The rate is as per the MM approved rate and exclusive of GST
2 HT Static CTPT Operated Smart Energy Meter 110V, -5A:3P-4W, accuracy Class 0.5S with mobile GPRS/3G/4G communication module including all accessories and warranty as specified.	1	No.	19753.13	19753.13	The Rate as per Director Office Order No.86/2024 Dated 09.05.2024
3 Earthing Electrode of 2 meters long/50mm diameter/2.89mm wall thickness/Terminal 30x10mm/inner pipi/outer pipe Of 250-100 microns galvanized with one (1.0) bag (22Kgs) BEC (Ultra)	1	No.	7153.05	7153.05	
4 HT Meter Box for Instrument Transformer Operated HT Energy Meter Pilfer Proof Complying to IP 65 including all accessories and warranty as specified (Technical Specification # M13)	1	Nos	8465.63	8465.63	The Rate as per Director Office Order No.86/2024 Dated 09.05.2024
5 Test Terminal Block for HT/LT Smart Static Energy Meters, 3-P, 4-W including all accessories and warranty as specified (Technical Specification # M12)	1	Nos	564.38	564.38	
6 Mounting Structure for CT PT	1	No	21446.25	21446.25	
7 GI wire 6 SWG	2	Kg	114.22	228.44	
8 Control Cable 10 Core, 2.5Sq.mm, Armoured	10	Mtr.	1117.46	11174.60	Company's Price list
9 Control Cable 4 Core, 2.5 Sq.mm, Armoured	10	Mtr.	502.30	5023.00	
10 Sundries (Small size N/B, M-Seal, All. Lugs etc.)	L/S	L/S	L/S	2500.00	
A Total Cost of Materials				158142.85	
B Add Labour Charge @ 10 % on 'A'				15814.28	
C Sub-Total				173957.13	
D Add Departmental charge @ 15 % on 'C'				26093.57	
E Taxable Value - (C+D)				200050.70	
F GST @ 18 % of 'E'				36009.13	
G Total				236059.82	
H Labour Cess @ 1 % on 'G'				2360.60	
I Grand Total				238420.42	
J SAY				238420.00	
(Rupees Two Lakh Thirty Eight Thousand Four Hundred Twenty) only					

as
29/9/24
Executive Engineer
Umiyam Distribution Division
MEPDCL, Umiyam

16/8/24
Assistant Executive Engineer
Umiyam Distribution Sub-Division
MEPDCL, Umiyam

Approved
Superintending Engineer
Ri-Bhoi Distribution Circle
MEPDCL, Umiyam

APPLICATION FORM FOR PROVIDING LT. SERVICE CONNECTION (FOR ALL CATEGORY AND FOR ALL PURPOSE)

The Area Manager/ Asstt Executive Engineer
Service Connection Sub-Division/ Distribution Sub-Division
MeECL _____

(Indicate the local area of the jurisdiction of the Engineer of the licensee)

Sir,

- 1 I/We hereby request you to supply electricity to the premises located at the address more fully described below. I/We are the owner/lawful occupier of the premises.
- 2 I/We agree to abide by the terms and condition relating to the supply of electricity by MeECL and to make all payments as may be required and also to pay regularly all charges as may become due.

- 3 a) Full name and address of the applicant with contact telephone number

EASTLINE BAMBOO INDUSTRIES

MIDC UMIAH

7530000690/9707128824.

- b) Status in relation to the premises

Owner

☐

Occupier

☐

- c) Location and address of the premises including Police Station.

- d) Nature of LT. supply :

Comercial

☒

Domestic

☐

Industrial

☒

General Purpose

☐

WSLT

☐

PL

☐

Agriculture

☐

KJ

☐

FOR EASTLINE BAMBOO INDUSTRIES

(Signature)

✓ Applicant's Signature Authorised Signatory

Date

NB : The following documents are to be enclosed

- 1) Test Report from Licensed contractor.
- 2) Agreement Form duly filled in.
- 3) Proof of ownership (in case applicant is owner)
- 4) Number of nearest Electric Pole.
- 5) NOC of the owner of the premises (in case the application is an occupier).
- 6) Attested copy of permission obtained from Pollution Control Board.
- 7) Blding permission from the concerned authority.



Annexure-3

Agreement for Supply of Electricity low tension

Agreement made this the _____ day of _____ of 20 _____
between _____ and his successor and assigns (hereinafter
referred to as the consumer) of the one part and the Meghalaya Power Distribution Corporation
Limited an electricity distribution licensee under the EA, 2003 and its successors and assigns
(hereinafter referred to as the Distribution / Utility / MePDCL) of the other part.

Note - the term 'consumer' includes an individual person (Whether male or female), a body of
persons, a company, society, firm, association or organization

Whereas, the consumer has applied to the distribution utility for supply of electricity to the
premises and the distribution utility has agreed to give the supply under the terms and conditions
hereafter appearing;

Now, therefore, the agreement witness -

(1). That the supply shall be given to the premises located at MIDC Umiam
with the Consumer as owner/occupier of;

(2). That the supply shall be for the purpose of Commercial Industrial
The load whereof shall not exceed 450 kVA or 360kwatts

(3). That the provision of the EA, 2003 and the regulations, code and orders including tariff orders,
as may be made from time to time by the MSERC shall apply and bind the consumers and the
distribution utility alike;

(4). That the consumer shall regularly and timely pay to MePDCL all charges may be due for the
supply of electricity;

(4-a). That the consumer shall pay the Transformer Maintenance Charge as stipulated in the license and thereby maintenance and replacement of the transformer on account of failure shall be the responsibility of the licensee.

(5). That the agreement shall be a period of two years and may be renewed for a further period. Provided that supply shall not be terminated by mere efflux of time if the consumer is willing that the agreement is renewed;


(6). That the agreement shall be terminated if the consumer on its part desires it so and gives to the MePDCL a prior notice of not less than one month or on the part of the MePDCL, if the consumer has violated any of the terms and conditions of the agreement.

Provided that on the part of the MePDCL notice shall be given to the consumer starting the reasons for the proposed termination and giving him opportunity to state his case and his statement, if any, duly considered before the agreement is terminated and the supply of Electricity cut off.

(7) The terms and conditions of this agreement shall be effective from the date of supply of electricity is commenced.

IN WITNESS WHEREOF the parties hereto have set their hands and seals the date, month, and year first above written.

FOR EASTLINE BAMBOO INDUSTRIES



Authorised Signatory

(For and on behalf of and by

Authorisation the) consumer.

For and on behalf of MePDCL

Witness :-

1. Signature : _____
Name : _____
Address : _____

2. Signature : _____
Name : _____
Address : _____

Energy Corporation Limited TEST REPORT

Required/renewed/additional/new electric installation at the premises of
E B A M B O O I N D U S T R I E S

(Please leave one block between name & surname)

U N I A M

Completed, tested and is ready for your Engineer to test and connect on your main line.
 The load has been arranged as follows

Details of Load	Wattage of each item	Phase - 1		Phase - 2		Phase - 3		Total watt of all 3 phases
		No. of points	Total watt	No. of points	Total watt	No. of points	Total watt	
1. Light points (i) Fluorescent (ii) Incandescent ✓ (iii) CFL (iv) Halogen (v) Others	20	10	200	10	200	10	200	600
2. Fan points								
3. Plug points (3-pin) ✓ (i) 6 Amps ✓ (ii) 16 Amps	100 1000	3 4	300 4000	3 4	300 4000	3 4	300 4000	900 12000
4. Electrical gadgets (i) Water Heater (Geyser) (ii) Refrigerator (iii) Air Conditioner ✓ (iv) Others	26000	1	26000	1	26000	1	26000	78000
5. Welding Transformer								
6. Motor 30HP	22380	4	89520	4	89520	4	89520	268560
Total			120020		120020		120020	360060
In case of load enhancement			-		-		-	
Existing load (in watts)			120.02		120.02		120.02	360.06
Total load in the premises (in watts) KVA -			150kVA		150kVA		150kVA	450kVA

Notes -

- (a) Details of any apparatus (other than the above mentioned) should be given.
 (b) Rating of capacitor used in Induction Motor and Welding Transformer (Test report of capacitor is to be enclosed).

KVAR

II. Type of wiring *casing and capping wiring*

III. Voltage and system of supply *440V*

IV. Test Result : *OK*

Date of Testing by Licensed Contractor :

--	--	--	--	--	--

Type of Test	Result of test carried out by licensed contractor (in M Ω) / Ω	Result of test carried out by the supplier under relevant IE Rules, in (M Ω) / Ω
a. Insulation resistance between earth and whole system of conductor	<i>130MΩ 130MΩ 130MΩ</i>	<i>130MΩ 130MΩ 130MΩ</i>
b. Insulation resistance between all conductors.	<i>130MΩ 130MΩ 130MΩ</i>	<i>130MΩ 130MΩ 130MΩ</i>
c. Earth continuity between earth electrode and earth continuity conductor.	<i>3Ω 3Ω 3Ω</i>	<i>3Ω 3Ω 3Ω</i>
d. Polarity of non-linked SP switches.		

V. Full Name with signature of Licensed contractor

LIC No.

S. Wahlang
S. Wahlang
Electrical Contractor

Regd. No *383*

VI. Full Name with signature of supervisor (with date)

LIC No.

K. Nongsie
K. Nongsie
Electrical Supervisor

Regd. No *1028*

VII. Full Name with signature of wireman (with date)

PERMIT No.

S. Wahlang
S. Wahlang
Electrical Wireman

Regd. No *2468*

VIII. Signature of the authorised official who tested The installation of behalf of supplier.

IX. Date of connection of supply to the installation