APPLICATION FORM FOR PROVIDING LT SERVICE CONNECTION (FOR ALL CATEGORY AND FOR ALL PURPOSE) for. The Area Manager/ Asstt. Executive Engineer Service Connection Sub-Division! Distribution Sub-Division D. C.L. Garobala. Sir. 1 / We hereby request you to supply electricity to the premises located at the address 1. more fully described below. I / we are the owner / lawful occupier of the premises. I / We agree to abide by the terms and conditions relating to the supply of electricity by Me.S.E.B and to make all payments as may be required and also to pay regularly all charges as may become due. a) Full name and address of the applicant with contact telephone number. 3. b) Status in relation to the premises. Owner Occupier c) Location and address of the premises including Police Station. Dilchi Ch. Langma, Modhupana P.o. Harrbon ha 79 South West Garo Hills Meghalay. d) Nature of LT supply: Commercial Domestic General Purpose l Industrial PL WSLT KJ Agriculture Del Chi Chi Sangma Applicant's Signature NB: The following documents are to be enclosed: 1) Test Report from Licensed contractor.

- 2) Agreement Form duly filled in.
- 3) Proof of ownership (in case applicant is owner)
- 4) Number of the nearest Electric Pole.
- 5) NOC of the owner of the premises (in case the application is an occupier) 6) Attested copy of permission obtained from Pollution Control Board.
- 7) Building permission from the concerned authority.

AGREEMENT FOR SUPPLY OF ELECTRICITY LOW TENSION

18 GREEMENT made this the

day of

BETWEEN

and hi

Successors and assigns (hereinafter referred to as the Consumer) of the one Part and The Meghalaya State Electricity Board an electricity distribution licensee under the Electricity Act, 2003 and its successors and assigns (hereinafter referred to as the Board) of the Other Part.

Note: The term consumer includes an individual person (weather male or female), a body of person, a company, society, firm, association or organization.

WHEREAS, the consumer has applied to the Board for supply of electricity to its premises and the Board has agreed to give the under the terms and conditions hereinafter appearing.

NOW, THEREFORE, the agreement witnesses -

- (3) That the provisions of the Electricity Act, 2003 and the Regulations, Code and Order, including Tariff Order, as may be made from time to time by the Meghalaya State Electricity Regulatory Commission shall apply and bind the consumer and the Board alike.
- (4) That the consumer shall regularly and timely pay to the Board all charges as may be due for the supply of electricity.
- (5) That the Agreement shall be for a period of two years and may be renewed for a further period:

Provided that supply shall not be terminated by mere efflux of time if the consumer is willing that the agreement is renewed;

EE OF COMMANCEMENT OF WORKS Date 28/11/25 Trymelline Sangma O. & P.S. Baghmara. South Garo Hills The Senior Electrical Inspector, Meghalaya, Shillong Notice before the commancement of Works under clause 36 of Electrical Licensing Board Regulations and conditions prescribed under Rule 29(1) of the Central Electricity Authority of Safety Regulation, 2010 I have the honour to inform you that the Additional / Alteration / Repair / New Electrical installation will be executed by me/us in the under mentioned premises and the particulars are as stated below: Owner of premises Details of Load. **Total Watts** Watts No. of Points Light points. Fluorescent tube Incandescent lamp 20 Halogen Others Fan point 150 Plug points 5/6 Amp. Socket 1000 15/16 Amp. socket Total: - 1360 Electrical gadgets Water heater Refrigerator Air condition Others Type of Wiring Date of Commancement

Subject:

Sir.

1.

2.

ii)

iii)

iv)

V)

i)

ii)

iii)

iv)

3.

4.

5.

6.

7.

8.

Name of Supervisor

Name of Workman

Insulation Tester Sl. No.


Earth Tester Sl. No. 2312

CFL


Make 3984 Make


Yours faithfully, Electrical contractor Lines



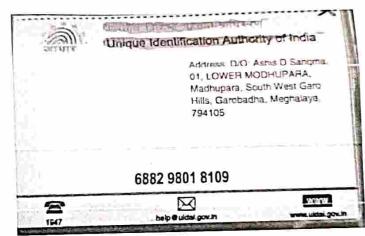

Dilché Ch. Sargmer.

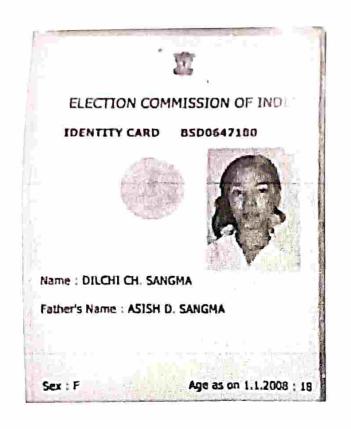

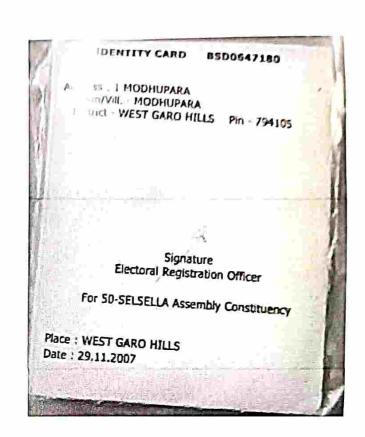

Déléhé Ch. Sangma.

ITEM

Single Phase Electronic Energy Meter

METER SL. NO.

10242H

TEST CERTIFICATE

RATING

5-20A | 5-30A | 10-40A | 10-60A,

240 Volts, 50Hz, class-1

METER CONSTANT

3200 Impulses per Kwh

STANDARD

IS:13779

The Meter was tested & has passed following routing test as per IS: 13779 at reference conditions:

| S.No. | TEST | RESULT | |
|-------|----------------------------|---|--|
| 01 | No-Load Conditions | Passed | |
| 02 | AC Voltage Test | Passed | |
| 03 | Insulation Resistance Test | Passed | |
| 04 | Starting Test | Passed | |
| 05 | Meter Accuracy Test | Passed Meter Accuracy Observed within +1% | |

| | | | 1 |
|-----------|---------------|---|------|
| ~ ··c · | Cianatura | | Data |
| Certified | Siunature | | Dale |
| | 5 | 3 7 7 5 7 1 6 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 | |