




BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED

(Wholly owned Government of Karnataka Undertaking)

No. EEMT/AEE(O)/BRAZ/AEE HTR/
To,
The Asst. Executive Engineer (Ele),
O&M Sub-Division,
BESCOM.

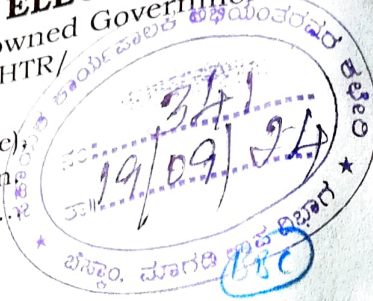

Office of the
Executive Engineer (Ele),
MT Division, BRAZ, BESCOM,
3rd Floor, Crescent towers,
Bangalore-560001.

Sir,

Date: 15.05.24

Subject: Rating Report of HT/EHT Installation.

The H.T. Installation having the following details has been rated for periodical rating/complaint on 15.05.24. You are requested to take action on the observations and advice recorded in the report. Compliance report shall be sent to this office on the observations pointed out in the report. Details are furnished in the Annexure enclosed.

1. DETAILS OF H.T. INSTALLATION:

R.R. No. RAHMEB-6..CD.....200.....KVA CTR.....101.....A Meter Constant.....1000
Activity Govt. Hospital. Tariff.....117-2(1)
Name & Address of the Consumer: Medical officer
Community Health Centre
Mogad

Previously rated on 22.12.23 (Add. 2 load)

2. OBSERVATION & ADVICE ON TECHNICAL MATTER:

The installation meter is calibrated, the error recorded is found to be within permissible limits.

3. ADVICE ON REVENUE MATTER:

Installation meter having constant 1000 & sanctioned load 200 VA from date 22.12.23 & kWh 644.931, but in bill meter constant & S.L not updated. As per BESCOM norms, shall claim for missing S.L & constant.

4. DOWNLOADED DATA ANALYSIS ENCLOSED: YES/NO.

Summary of analysis if rated against complaint.....

ANNEXURE

1. DETAILS OF SEALS:

R.R. No.....

SL. No.	Seals Provided to	Sl. No. of Seals Found Plastic		Sl. No. of Seals Left Plastic	
		Main Meter	Check Meter	Main Meter	Check Meter
1	M.C. of Meter	RAHMEB/1067801 BRAZAS1107 BRAZ86229		Retained	
2	TC Of Meter				
3	M.D. Reset Knob				
4	Optical Port	BRAZ86990 BRAZ86991		BRAZ86996 BRAZ86997	
5	T.T.B				
6	Meter Chamber Main Door	BRAZ86992 BRAZ00740 (Broken)		Retained BRAZ86848	
7	Meter Reading Window				
8	C.T./P.T. Chamber				
9	Cable Entry Chamber				
10	Hologram				

2. DETAILS OF THE EQUIPMENTS:

- a) Cubicle Type : Cable Entry / 6 bushing / 3 busing / LBS. Make.....Sl. No.....
b) Cubicle Conditions & Location.....Govt

3. MULTIPLYING CONSTANT (MC) FOR BILLING (Kwh. Kvah. Kva) :

$$MC = \frac{PT \text{ Ratio} \times CT \text{ Ratio} \times \text{Dial Constant}}{\text{Meter PT Ratio} \times \text{Meter CT Ratio}} = \frac{(110V/3) \times (110V/3) \times (101) \times 1}{1 \times 1} = 1000$$

4. DETAILS OF Ct's/ Pt's: