

Registration Fees-61.9067

## Bengaluru Electricity Supply Company Limited (Wholly Owned Government of Karnataka Undertaking)

**BESCOM GSTN No: 29AACCB1412G1Z5** 


## **New Connection Application form**

Application No.: 1113111250030Sub Application No.:

Sub Division:

25

13111250030000	1		DABASPETE
h	Applicati	ion Details	
Icant Name	M/S SASI REKA	Spouse/Father Name	
Address	PLOT NO.480, NELAMANGALA TALUK, 2nd STAGE SOMPURA KIADB I/A SOMPURA HOBLI	Corresp Address	PLOT NO.480, 2nd STAGE SOMPURA KIADB I/A SOMPURA HOBLI, NELAMANGALA TALUK
le	9449024648	Email Id	RTMINDIA@HOTMAIL.CO
	AEUPT3725K	Adhar No	668951704825
No Ication Date	10-NOV-2025	Tariff	HT2A
Cation Date	Locatio	n Details	
171	BANGALORE RURAL	Taluk	NELMANGALA
lct	MANNE	Village	2 ND STAGE SOMPURA INDUSTRIAL AERA
de	0		
	Addition	nal Details	
esis Located in	KIADB	Site Dimension (Sq m)	8040
p Area (Sq Mtrs)	2500	Phase	3-PHASE
7	Licens	e Details	
Vame	GOLD FINCH ELECTRICALS	LEC License Number	1CL100802SMG
icense Upto	31-01-2028		10D400040DNC
visor Name	RAVIKUMAR G	Supervisor Permit No	1SP163210BNG
visorm LEC Valid	30-11-2028		
	Power Su	pply Details	
cation Type	Permanent Service	Voltage Class	11KV
ose	HT Industrail	Requested Load (KVA)	100
<del></del>		ration Fee	
			Amount
Char	rge Type		

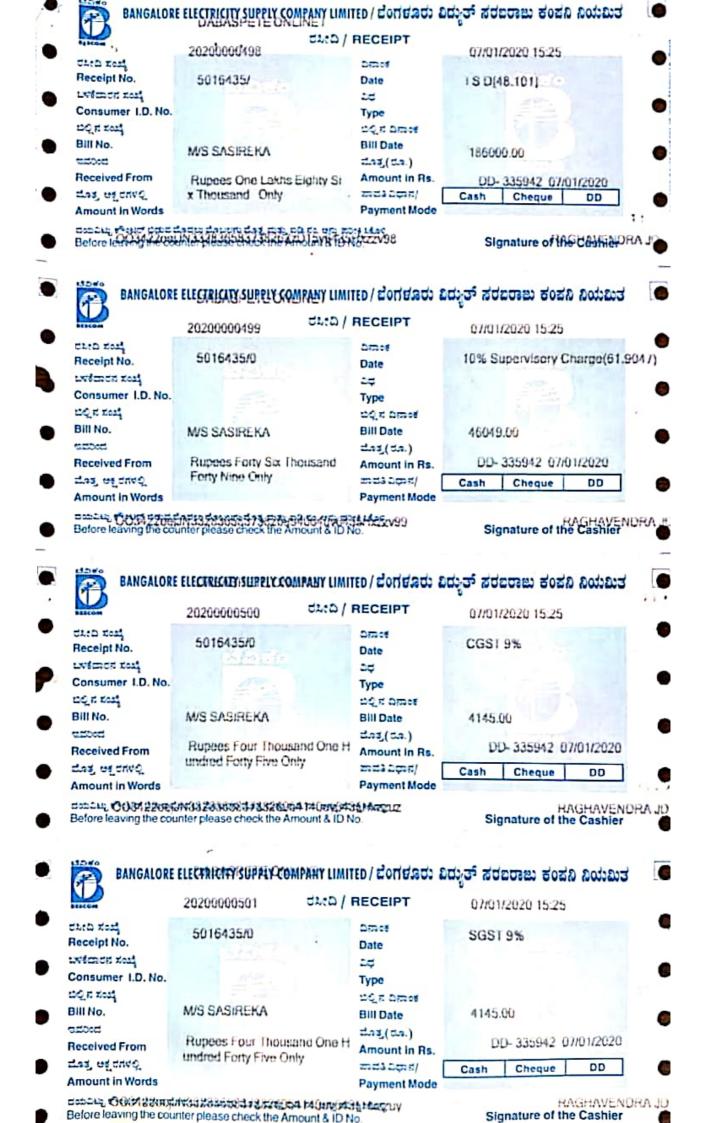

2.40.339/

work.

- The HT metering cubicle is to be installed at main entrance of your premises preferably within independent entrance so as to have easy access to BESCOM staff. The tapping GOS shall be placed 1 Prior approval for makes of distribution materials used in the 11 KV line like 11 KV GOS, pin / disc insulators etc. shall be taken in writing from the jurisdictional engineer. The construction shall confirm to approved BESCOM, standards. As per the O.M of GM (Ele.) CA BESCOM B'lore vide O.M No. BESCOM/BC-16/332/2011-12/6685-J 99/dtd. 9.11.11 You are requested to obtain inspection report for all the materials procured for execution of work, from the jurisidiction Executive Engineer (Ele)/Asst. Executive Engineer Sub-division before commencement of work
- C) You have to forward the following documents to jurisdictional Executive Engineer, O&M Division. Execute HT power supply agreement in the prescribed form in triplicate, original duly stamped on Rs:-Α 200/-В Submit the contractors completion\_cum\_test report along with lists in duplicate of machinery you intend power. The capacity of any individual equipment / machinery installed / connected shall not be more than the contract demand. C Execute an agreement on Rs:-100/- stamp paper for executing the HT line as per Corporation specification s and sanctioned estimate. The work order is valid initially for 3 months for executing the service line

D) For servicing the HT installation, you have to submit the following: Approval of Electrical inspectorate for commissioning the HT service line (including RMU's cables), your Λ transformer etc.. В Pre-commissioning tests conducted on HT metering cubicles of MRT Division of BESCOM which will be arranged by jurisdictional BESCOM Bangalore. C These statements of material listed in sanctioned estimates giving make/ quantities duly signed by you for taking over by BESCOM for maintenance. Approval of Electrical Inspectorate in case the height of your building is above 50 Ft measured from ground level to D top roof (if applicable) Kindly note that arranging the metering cubicle / approvals etc., would take time and hence your early action to pay Ξ the deposits etc., and observance of the above formalities will help BESCOM to arrange the power supply when you need You may please contact this office or jurisdictional Executive Engineer, El, for any clarification.

Note: Occupancy certificate should be produced by consumer before service

Yours Faithfully.


(C, O&M) Division, BESC Nelamanagala



## Bangalore Electricity Supply Company (BESCOM)

(Wholly owned Government of Karnataka Undertaking)

## New Connection Application Acknowledgement

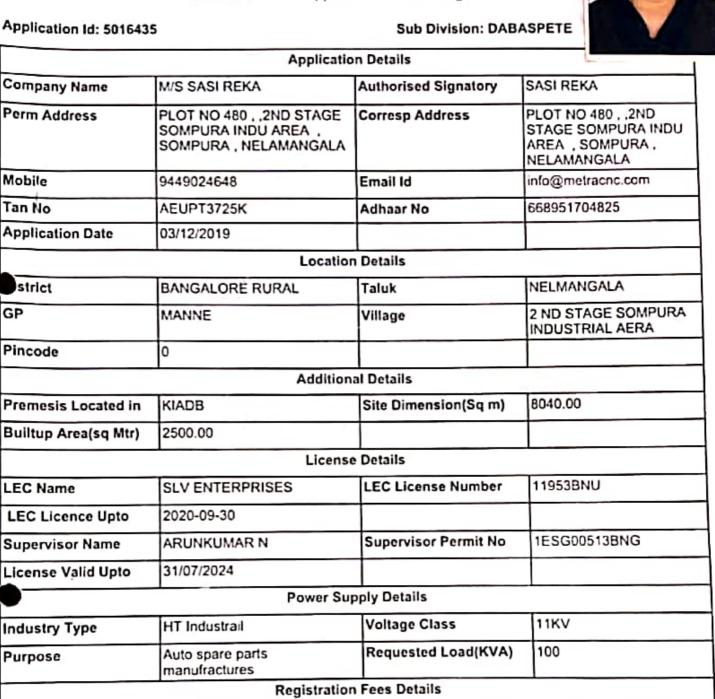

Proof Type	Document Type	Proof ID NO
Authorization documents in case of firm or Company	Partnership deed in the case of a partnership firm,	KIADB/1663/201617/
Proof of Identity of the Users	Aadhar card	668951704825
Proof of Ownership of the premises	Proof Of Ownership of the premises (Registered Sale deed,Registered Partioned deed,Registered deed of last will ,Registered Gift deed,	8127

NOTE: Registration Fees of Rs. 295/- is to be Paid within 30 days of Application Registration.

Rs.250/-

Rs.22.5/-

Registration Fess

SGST Fees

**CGST Fees** 

Rs 22.5/-

Bangalore Electricity Supply Company Limited

(Wholly Owned by Govt. of Karnataka Undertaking)

NO:- EEDNEL/ AEE (O)/ AE-T/19-20/

8155

Office of the
Executive Engineer (Ele),
(C, O&M) Division, BESCOM
Nelamangala.
3 1 2020

TO.

M/s. Sasireka Plot no. 480 Hnd stage Sompura Indl. area Thyamgondlu section of Dabaspet sub division.

Sub:- Arranging 100 KVA HT Power supply to the Installation of M/s. Sasireka Plot no. 480 Hnd stage Sompura Indl. area Thyamgondlu section of Dabaspet sub division Ref:-1) Under section-8 of KERC code 2004

With reference to the above, BESCOM is pleased to arrange power supply to an extent of 100 KVA under tariff HT 2a (II)

	A. You are requested to pay the following deposits			
A	ISD Rs. 186000/-			
•	Electrical Inspectorate amount as applicable @ DEI Office			
C	The Meter cubicle shall be purchased by the consumer at his own cost from vendors approved by BESCOM			
D	Supervision charges 10% on estimate cost of Rs. 46049/-			
E	9% of CGST on supervision charges Rs. 4145/-			
F	9% of SGST on supervision charges Rs. 4145/-			

The above amounts are required to be deposited in the form of D.D. drawn in favour of AEE, BESCOM, Dabaspet Sub Division (cash if less than Rs.10000/- at the jurisdictional sub division cash counter at Dabaspet Sub Division and forward Xerox copies and a certificate of payment signed by Asst. Ex. Engineer, El., / Asst. Accounts officer or Sr. Assistant. you need not have to pay the D-11 mentioned in (C) above, if you agree to provide the HT metering cubicle at your cost, the make / type/ drawing of which has to be approved by jurisdictional O&M Ex. Engineer, El / MT Ex. Engineer, El. You have to pay the above charges within 90 days from the date of this letter.

	B. General Information.
Λ.	The power supply will be arranged at 11 KV at HT 2a (II) tariff.
B	You should own and install necessary distribution transformer of adequate Capacity at your end for
С	In case you are not able to execute the HT line works (For Govt, installation only). You may deposit the
D	You have to install approved make shunt capacitors of appropriate capacity, so as to maintain overall
Е	are liable to pay the Tariff minimum charges from the date of commencement of supply i.e., actual date of servicing or expiry of 30 days notice issued to you by the Corporation to avail service, whichever is
F	You have to produce necessary license / permit / NOC issued by the competent authorities as required
G	In case, you are not desirous of availing power supply, the amount paid by you towards Initial Security Deposit, meter Security Deposit, meter security deposit and cost of line extension etc., will be refunded on application after deducting 10% of total amount in case corporation has not commended its portion of works.