ddaballapura Rural Sy No 150/1, Kenjiganahalli Village. Srinivasa Balaramaiah S/o Balaramaiah H,

> (C.O&M) DIVISIONNELAMANGALA, EXECUTIVE ENGINEER, ELE. NELAMANGALA., OFFICE OF THE Seac 11/2

nasawadi Section, Doddaballapura Rural Sub Division. Under Self execution. aramaiah SUB: For Arranging Power Supply to 10 HP IP Set installation in favour of Sri S/o Balaramaiah H , at Sy No 150/1, at Kenjiganahalli Village Srinivasa Limits in

1.Govt of Karnataka Order no Energy/VSC/214/2023/07.10.2023. 2.BESCOM/CGM(Proj)/DGM-1/AGM/2023-24/CYS-193/12.10.2023 3.AEE/AET/DBPR/24-25/4665/04.01.2025..

njiganahalli Village stallation in favour of Sri Srinivasa Balaramaiah S/o Balaramaiah H, at Sy No 150/1, at vision.we are pleased to sanction the power with the following terms and conditions With reference to your application requesting For Arranging Power Supply to 10 HP IP Set Limits in Kanasawadi Section, Doddaballapura Rural

DD at the office of the Asst.Exec.Engineer(Ele), BESCOM Doddaballapura Rural sub-division.

You have to pay Transformer Testing charges of Rs.1000/- (Rupees. One Thousand Only)) by cash / DD at the office of Pay 05% SC On Estimate Rs. 12,478/-(Rupees Twelve Thousand Four Hundred & Sventy Eight Rupees Only) by cash / Pay Rs. TPBOX Rs. 3106/-(Rupees. Three Thousand One Hundred & Six Only) Pay Rs. MSD Charges Rs. 3312 /-(Rupees. Three Thousand Three Hundred & Tweleve Only) The Meter should be purchased by the consumer at his owncost at the retail outlet approved by KPTCL/BESCOM 07 and allied amendments You have to enter into an agreement with the Corporation in the prescribed format as per Electricity supply and distribution The tariff applicable to your installation will be under LT-4 (a) Tariff in force. The power supply will be arranged at 400 Volts. You have to pay ISD charges Rs.17,000/- (Rupees. Seventeen Thousand Only)by cash /DD at the office of the Asst.Exec.Engineer(Ele)BESCOM Doddaballapura Rural Sub Division Asst.Exec.Engineer(Ele), BESCOM Doddaballapura Rural sub-division

as per Regulation 409. No fuses shall be provided on the neutral conductor. BESCOM, Which must be erected with in one meter of the Company's meter Board in such other position as shall be approve You should provide circuit breakers of appropriate capacity (MCB) and Current Operated Earth Leakage relay (ELCB) as pre-

Licensed Contractor in co- ordination and under the guidance of KPTCL/BESCOM officialLs 11 KV/LT system shall be as per KPTCL/BESCOM standard practices. The entire Distribution system with connected equipments shall be taken over by KPTCL/BESCOM after completion of The applicant has to execute the works under self-execution through Karnataka State government approved Class I Electrical

insulators and 11 kV single/double break GOS shall be procured by the agencles only from the BESCOM approved vendors and other materials may be procured from authorized dealers of approved vendors to BESCOM. You have to utilize only Polymer Insulators as per corporate circular vide Lr no. BESCOM/BC-9/CGMICA)/DGM(CA-31/F-752/13-14/CYS-113 dt The materials used shall confirm to 151/BESCOM/KPTCL specifications and the materials procured should be got inspected before commencing of work by the concerned Asst ExecutiveEngineer Ele... BESCOM

You shall submit the copies of the invoices / bills in respect of the materials purchased by you for proof of having purchased materials for the copies of the invoices / bills in respect of the materials purchased by you for proof of having purchased All the major materials like Transformers. ACSR conductor, Metering cubicle. HT UG cable, LT UG cable, 11 KV Pin

Guarantee shall be furnished for a period of not less than one year for the materials used in the works as well as for the materials from the approved vendors/dealers.

Nota.	0	30	29	28	27	26	25	24	23	22	21	20	19	18	
and the state of t	premises, he released materials. If any, as per the 7th schedule credit estimate shall be handed over on "As is where it to the concerned divisional stores."	You have to pay any variation / difference of charges. If any, payable to BESCOM/ KPTCL in future as per subsequence shall furnish the control of the contro	You should abide to the condition, where dry type transformers, cable entry type transformers, compact sub-stations a maintained for the entire life time by the consumer	Any delay in making the payment, not fulfilling the above payments within 90 days, the power sanction/application days as per the conditions stipulated in the KEBC American days.	In case, the applicant falls to meet the above conditions power sondi-	y the conditions of sumply of electricity 2004 in 6	You have to provide additional infrastructure required as and when there is increase in load by the individuals in the	You should clear the out-standing arrears. If any.	You have to produce NOC from respective PGCIL/ KPTCL In case any, EHV lines passes in the layout before available to the land / layout.	In case, any EHT and HT/LT lines passing through the layout safety clearance to be maintained (statutory) or shifting	After payment of above charges and fulfillment of the conditions. Theadministrative approval will be issued for	The BESCOM / KPTCL is not responsible in whatsoever manner regarding any of legal disputes that may arise at a	You have to obtain the approval of Electrical Inspectorate for new HT/LT lines/ DTCS. Forest clearance, statutory cle	Proof of having purchased the materials and these are used for execution of works from the reputed firm will be verificated.	quality of the works canted out from the date of taking over the lines and equipments by BESCOM VETC

completion of work in future. 1. Consumer is only responsible for any objections while executing the work

and equipments should be maintained for 1 year at the owner cost. 2. Undertaking letter in Rs.500/- e-stamp paper should be produced Stating that ma

(C,O&M) DIVISION BESCOM


ENGINEER, ELE.,


Yours faithfully


NELAMANGALA.

Application ID No 9767708

Scanned with OKEN Scanner

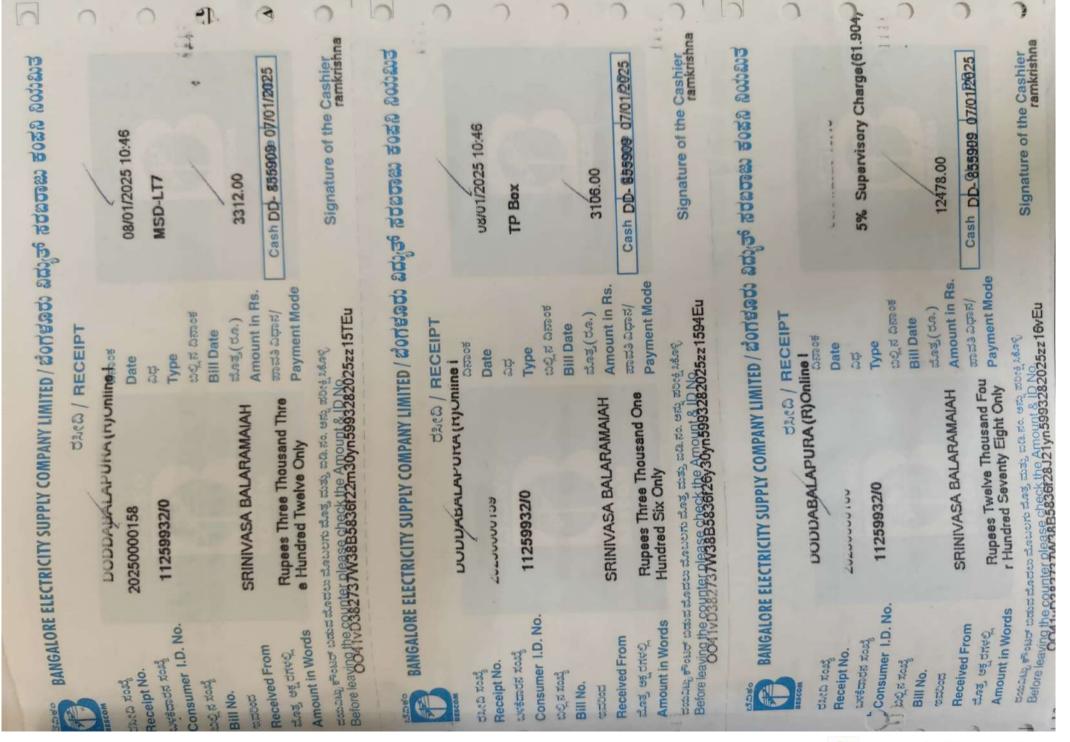

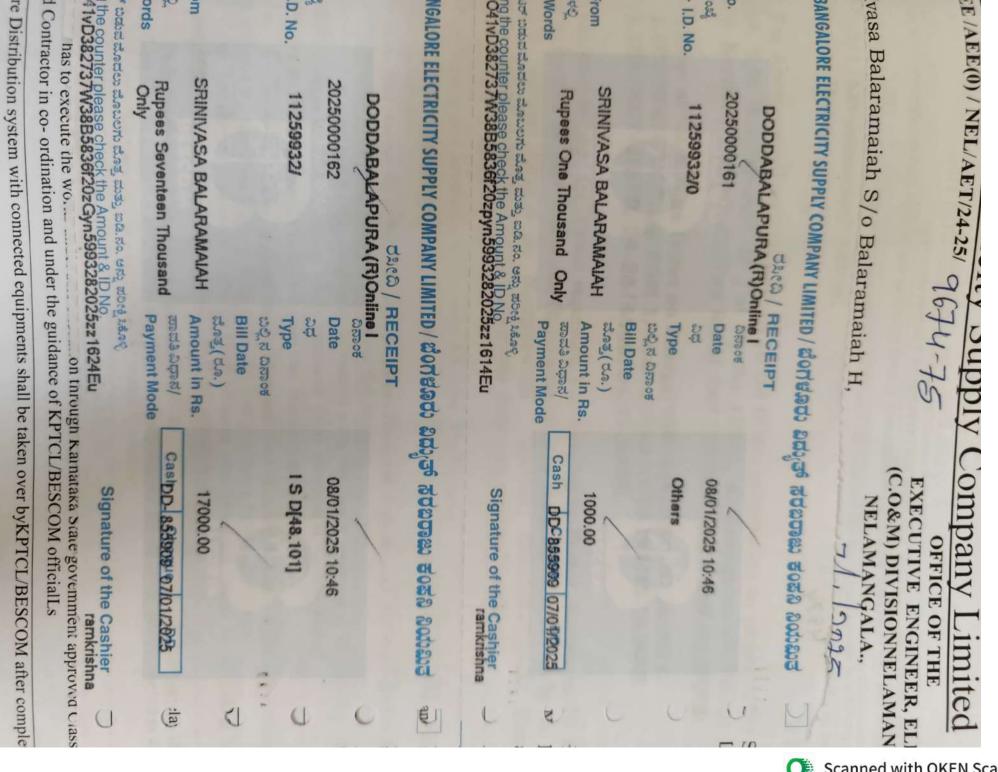

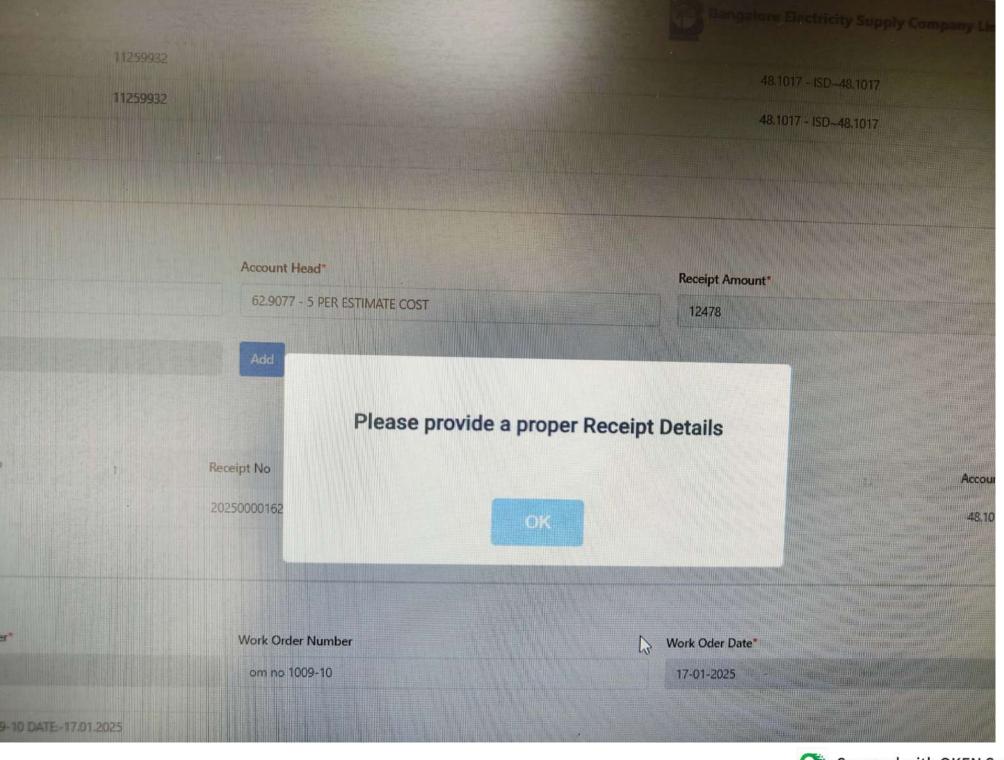

BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED

(Wholly owned Government of Karnataka Undertaking)

(E)/AAO/JA/24-25/ 4974

3250



Office of the,

Asst Executive Engineer (Ele) Com, O&M Rural Sub division, BESCOM, Doddaballapura Phone:-8277892573 Aeedoddaballapurarural@gmail.com

Date: 08 01 2025

"PAYMENT CERTIFICATE"

Sub:- Sri Srinivasa Balaramaiah S/o Balaramaiah H Payment Detail

Ref:- EE(E) AEE(E)AE(T)NEL No 9674-75 dated 07-01-2025.

With reference to the above For Arranging power supply to 10HP IP set installation in favour of Sri Srinivasa Balaramaiah S/o Balaramaiah H at Sy No 150/1 at kenjignahalli Village Limits in kanasawadi Section of Doddaballapura Rural Sub Division.

Under Self execution .

The Consumer paid the following Deposits .

DD	855909	07-01-2024	DATE		
C5ARGES	AMOUNT	RT NO			
ISD	17000/-	20250000162			
MSD	3312/-	20240000158			
тр вох	3106/-	20240000159	08/01/2025		
TRANFORMER TESTING	1000/-	20250000161			
CHARGE 5% SUPERVISORY CHARGES	12478/-	20250000160			
TOTAL	36896/-				

Assistant Executive Engineer (Ele).

C,O&M Rural Subdivision, BESCOM

Doddaballapura

Сору То

The Excecutive Engineer (Ele), BESCOM, Nelamangala Division, Nelamangala.

