


SKETCH:

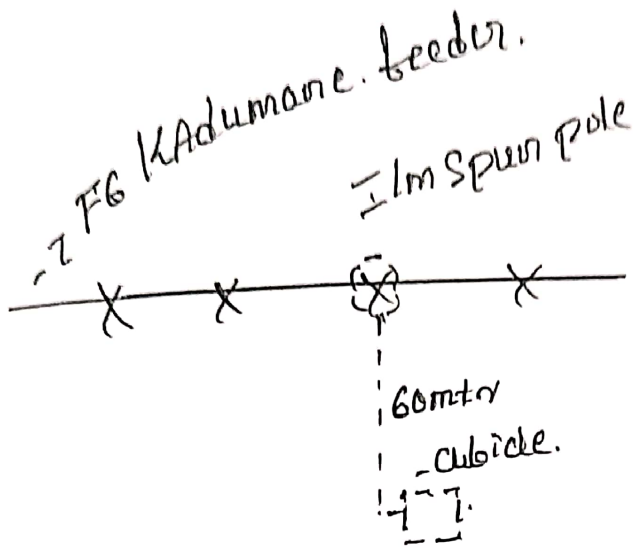

INDEX

- X EXISTING PULPSC pole
- EXISTING 11KV line
- (X) proposed 11m Spun pole.
- - - proposed HT Wtr. Cable
- [] proposed cubicle.

Assistant Executive Engineer (Elec).
BESCOM, Bidadi,
Bidadi Sub-Division.

Junior Engineer (Elec).
BESCOM, Manchanayakanahalli,
Bidadi Sub-Division.

8. Whether display parameters of ETV meter are as per BESCOM requirement : YES/MO

578

9. Seals Fixed :

Initial Reading of ETV Meter :

| Sl. No. | Particulars | Lead | Plastic |
|---------|-------------------------|------------|----------|
| 1. | Main cover of Meter | BRNO450051 | AKM12309 |
| 2. | Terminal cover of Meter | BRP2BL7330 | |
| 3. | MD. Reset Knob | L7331 | |
| 4. | Optical Port | | |
| 5. | T.T.B. | L7332 | |
| 6. | Metering Cubical Door | L7333 | |
| 7. | Window | | |
| 8. | CT / PT Chamber | L7334 | |
| 9. | Cable Entry Chamber | L7335 | |
| 10. | Hologram | NT-110533 | |

10. Transformer Details

a) Make Polbay Tech
 b) Voltage Class 11000/433V
 c) Transformer Capacity 360
 d) Current (HT/LT in amps) 333.1/840.01
 e) Vector Group % Z DN-11
 f) SI.No. PTC-2200

Present MD 0.000
 Billing MD 0.000
 Anomaly 000
 MD Reset Count 01
 Cum. Demand 0.518
 Bill PF ---

1. Observations NA. Meter is regulated by APT. No. 2077/Dr. 11/12/25
Checked the connection for correct wiring of CT & PT & relay
OK. All is tested & standard as per meter.

S. D. Muralias
 Consumer / Representative
 Signature with Seal

Executive Engineer Elec., MT Division, BRAZ, BESCOM, Bengaluru
 Executive Engineer Elec., O & M Prasen Division, BESCOM, Bengaluru.

Yours faithfully,
S. D. Muralias
 Asst. Executive Engineer Elec.,
 HT Rating Sub-Division Prasen
 BRAZ, BESCOM, Bengaluru